SOUTHERN NEVADA BUILDING OFFICIALS REGIONAL STANDARDS

E - 105-24-6--08 PG. OF

TEMP. CONST. POWER THROUGH MAIN ELECT.-BLDG. SRVC SINGLE FAM. DWELLINGS

Clark County

Dept. of Develop. Services 4701 W Russell Rd Las Vegas, NV 89118 (702) 455-3000

Boulder City


Building Department 401 California Avenue Boulder City, NV 89005 (702) 293-9282

Henderson

Bldg & Fire Safety Dept. 240 Water Street Henderson, NV 89015 (702) 267-3650

Las Vegas

Building & Safety Dept. 731 S. 4th Street Las Vegas, NV 89101 (702) 229-6916

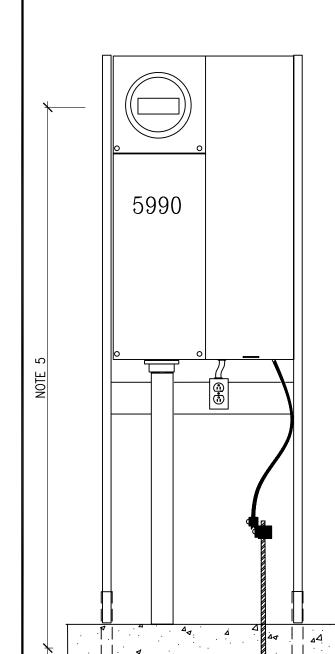

- FRAMING SUPPORTS MUST BE 2-1/2" ANGLE IRON, OR 1-5/8" X 3-5/8" 16 GA. STEEL STUDS EMBEDDED IN CONCRETE. THE SERVICE PANEL IS TO BE SECURED PER MANUFACTURERS INSTRUCTIONS.
- ALL RECEPTACLES FOR CONSTRUCTION POWER SHALL BE GFCI PROTECTED PER NEC 590.6 AND MUST BE RIGIDLY ATTACHED TO THE STRUCTURE OR SERVICE EQUIPMENT.
- THE GROUNDING ELECTRODE IS TO BE MOUNTED IN THE SAME BAY AS THE SERVICE. THE GROUNDING ELECTRODE CONDUCTOR IS TO BE SIZED PER NEC, TABLE 250.66 AND IS TO BE INSTALLED PER NEC 250.64.
- THE ADDRESS IS TO BE POSTED ON THE SERVICE FOR THE INSPECTION.
- LOCATE THE METER 4 FT MIN. AND 6 FT 3" MAX. ABOVE FINISHED GRADE.
- TEMPORARY WEATHERPROOFING SHALL BE PROVIDED TO PROTECT ELECTRICAL EQUIPMENT FROM RAIN OR WINDBORNE SAND.

Mesquite

Building Department 10 East Mesquite Blvd. Mesquite, NV 89027 (702) 346-2835

North Las Vegas

Δ

Building Department 2240 Civic Center Drive N. Las Vegas, NV 89030 (702) 633-1577

Pahrump

Δ

40

4

Regional Planning District 1210 E. Basin Avenue, Suite #1 Pahrump, NV 89060 (775) 751-3373